

## AKUMULATOR NPP - HR 1234W

NPP HR 1234W akumulator VRLA 12V i pojemności 9Ah.



### TABELA CZASU ROZŁADOWANIA PRZY STAŁYM POBORZE MOCY DLA 25 °C

V/Time	F.V/Time	5min	10min	15min	20min	30min	45min	60min	2h	3h	4h	5h
9,6 V	1.60V/cell	434,8	264	211,8	167,4	113,4	84	69	39,48	28,32	22,8	19,62
10,02V	1.67V/cell	415,1	252	204	160,8	109,8	81	67,2	39,12	28,08	22,62	19,44
10,2V	1.70V/cell	404,0	245,4	198,6	157,2	108	79,8	66,0	38,88	27,96	22,50	19,32
10,5V	1.75V/cell	386,8	234,6	192	151,8	105	78	64,8	38,34	27,78	22,38	19,20
10,8V	1.80V/cell	365,3	222	181,8	144	101,4	75	62,4	37,32	26,94	21,66	18,66

### PARAMETRY PODSTAWOWE

Liczba cel	6
Napięcie znamionowe	12 V
Pojemność / Moc	9 Ah dla 20 h rozładowania do 1,75 V na ogniwo przy 25°C
Waga	Około. 2,6 kg
Maksymalny prąd rozładowania	135 A (5 sek.)
Opór wewnętrzny ok.	nie więcej niż 17 mΩ
Zakres temperatur pracy	Rozładowanie : -15°C ~ 50°C Ładowanie : -10°C ~ 50°C Przechowywanie : -20°C ~ 50°C
Nominalny zakres temperatury roboczej	25 °C ± 3 °C
Napięcie ładowania podtrzymującego	13,6 do 13,8 VDC / przy 25 °C
Zalecany maksymalny limit prądu ładowania	2,7 A
Obsługa wyrównawcza i cykliczna	14,4 do 15,0 VDC / przy 25°C
Samorozładowanie	< 3% na miesiąc
Terminal	F2-Faston Tab 250
Materiał pojemnika	ABS , UL94-HB



[www.npp-power.eu](http://www.npp-power.eu)



## HR1234W

Valve-regulated lead-acid battery

## HIGH RATE SERIES


### Characteristics

Nominal voltage	12V (6 cells per unit)	
Nominal power at 15 min. rate 1.67V/cell (25°C)	34W	
Capacity (25°C)	20 Hours rate/10.5V	9Ah
	5 Hours rate/10.5V	7.95Ah
Terminal type	T1/T2	
Torque	N/A	
Approx. internal resistance (25°C)	17.0 mΩ	
Dimensions	Length	151±1.5mm (5.94inch)
	Width	65±1mm (2.56inch)
	Height	94±1mm (3.70inch)
	Total height	100±1mm (3.90inch)
Design Life (stand-by)	JIS at 25°C	5 years
	Eurobat at 20°C	3-5 years
Weight	2.60kg (5.51lbs)±4%	
Nominal operating temperature	25±3°C (77°F±5)	
Operating temperature range	Discharge	-15°C~50°C (5°F~122°F)
	Charge	-10°C~50°C (14°F~122°F)
	Storage	-20°C~50°C (-4°F~122°F)
Float charging voltage at 25°C	13.6V~13.8V	
Cyclic charging voltage at 25°C	14.5V~15.0V	
Temperature compensation	Float charge	-18 (mV/°C/Block)
	Cycle charge	-30 (mV/°C/Block)
Max. charging current (A)	2.72A	
Max. discharge current for 5 seconds	135A	
Self discharge rate (25°C)	≤3%/month	
Battery container ABS UL94-HB	V-0 optional	

### Overview

NPP Power High Rate series batteries are specially designed for applications that require high power output. With their high-power density and low internal resistance, the HR series are the right choice for your most demanding applications.

### Dimensions & Terminal Type (mm)

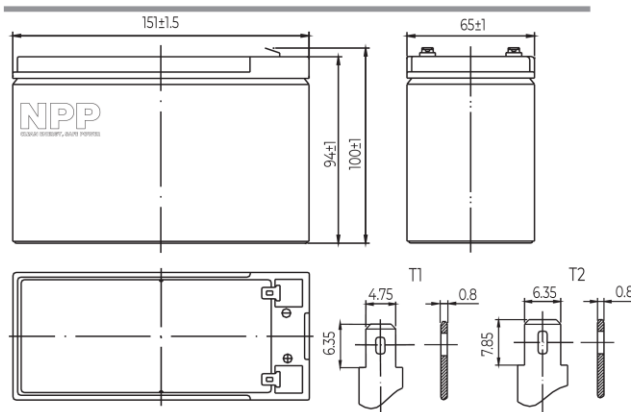

### Certification & Compliances



Compliant to: EUROBAT, RoHS, WEEE's and Reach.  
Manufactured according to IEC 60896-21 / 22

### Construction

Component	Positive Plate	Negative plate	Container	Separator	Electrolyte	Safety valve	Terminal
Raw material	Lead dioxide	Lead	ABS (V-0 opt.)	AGM	Sulfuric Acid	Rubber	Copper

### Constant current discharge characteristics at 25°C

(Ampere/cell)

F.V/Time	5min	10min	15min	20min	30min	45min	60min	2h	3h	4h	5h
1.60V/cell	38.64	23.84	17.80	14.10	9.55	7.07	5.78	3.31	2.35	1.89	1.62
1.67V/cell	36.96	22.79	17.20	13.50	9.24	6.84	5.64	3.28	2.33	1.87	1.61
1.70V/cell	35.91	22.16	16.70	13.20	9.07	6.72	5.55	3.26	2.32	1.87	1.60
1.75V/cell	34.44	21.21	16.20	12.80	8.85	6.55	5.44	3.21	2.30	1.85	1.59
1.80V/cell	32.45	19.95	15.30	12.10	8.53	6.31	5.27	3.13	2.23	1.80	1.55

### Constant power discharge characteristics at 25°C

(Watts/cell)

F.V/Time	5min	10min	15min	20min	30min	45min	60min	2h	3h	4h	5h
1.60V/cell	72.47	44.00	35.30	27.90	18.90	14.00	11.50	6.58	4.72	3.80	3.27
1.67V/cell	69.19	42.00	34.00	26.80	18.30	13.50	11.20	6.52	4.68	3.77	3.24
1.70V/cell	67.34	40.90	33.10	26.20	18.00	13.30	11.00	6.48	4.66	3.75	3.22
1.75V/cell	64.47	39.10	32.00	25.30	17.50	13.00	10.80	6.39	4.63	3.73	3.20
1.80V/cell	60.89	37.00	30.30	24.00	16.90	12.50	10.40	6.22	4.49	3.61	3.11

The above characteristics represent average values and can be obtained within three charge and discharge cycles. The batteries must be fully charged before testing. The data in this document is subject to change without notice and become contractual only after written confirmation. Please contact NPP Power for the latest available version.